503.5 Vertical Clearance. Vehicle pull-up spaces, access aisles serving them, and a vehicular route from an entrance to the passenger loading zone, and from the passenger loading zone to a vehicular exit shall provide a vertical clearance of 114 inches (2895 mm) minimum.

504 Stairways **504.1 General.** Stairs shall comply with 504.

504.2 Treads and Risers. All steps on a flight of stairs shall have uniform riser heights and uniform tread depths. Risers shall be 4 inches (100 mm) high minimum and 7 inches (180 mm) high maximum. Treads shall be 11 inches (280

504.3 Open Risers. Open risers are not permitted.

504.4 Tread Surface. Stair treads shall comply with 302. Changes in level are **EXCEPTION:** Treads shall be permitted to have a slope not steeper than 1:48. **504.5 Nosings.** The radius of curvature at the leading edge of the tread shall be 1/2 inch (13 mm)maximum. Nosings that project beyond risers shall have the underside of the leading edge curved or beveled. Risers shall be permitted to

slope under the tread at an angle of 30 degrees maximum from vertical. The permitted projection of the nosing shall extend 1 1/2 inches (38 mm) maximum ovarithe tread below.




Figure 504.5 Stair Nosings

504.6 Handrails. Stairs shall have handrails complying with 505. **504.7 Wet Conditions.** Stair treads and landings subject to wet conditions shall be designed to prevent the accumulation of water.


505.1 General. Handrails provided along walking surfaces complying with 403, required at ramps complying with 405, and required at stairs complying with 504

505.2 Where Required. Handrails shall be provided on both sides of stairs and

EXCEPTION: In assembly areas, handrails shall not be required on both sides of aisle ramps where a handrail is provided at either side or within the aisle width. **505.3 Continuity.** Handrails shall be continuous within the full length of each stair flight or ramp run. Inside handrails on switchback or dogleg stairs and ramps shall be continuous between flights or runs.

EXCEPTION: In assembly areas, handrails on ramps shall not be required to be continuous in aisles serving seating. **505.4 Height.** Top of gripping surfaces of handrails shall be 34 inches (865 mm)

minimum and 38 inches (965 mm) maximum vertically above walking surfaces, stair nosings, and ramp surfaces. Handrails shall be at a consistent height above walking surfaces, stair nosings, and ramp surfaces.

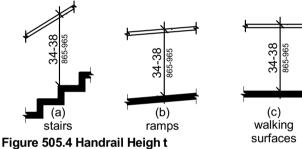

505.5 Clearance. Clearance between handrail gripping surfaces and adjacent surfaces shall be 1 1/2 inches (38 mm) minimum.



Figure 505.5 Handrail Clearance

505.6 Gripping Surface. Handrail gripping surfaces shall be continuous **505.6 Gripping Surface.** Handrail gripping surfaces shall be continuous along their length and shall not be obstructed along their tops or sides. The bottoms of handrail gripping surfaces shall not be obstructed for more than 20 percent of their length. Where provided, horizontal projections shall occur 1 1/2 inches (38 mm) minimum below the bottom of the handrail gripping surface. **EXCEPTIONS:**

1. Where handrails are provided along walking surfaces with slopes not steeper than 1:20, the bottoms of handrail gripping surfaces shall be permitted to be obstructed along their entire length where they are integral to crash rails or bumper guards.

2. The distance between horizontal projections and the bottom of the gripping surface shall be permitted to be reduced by 1/8 inch (3.2 mm) for each 1/2 inch (13 mm) of additional handrail perimeter dimension that exceeds 4 inches (100 mm).



Figure 505.6 Horizontal Projections Below Gripping Surface

complying with 505.7.1or 505.7.2. **505.7.1 Circular Cross Section.** Handrail gripping surfaces with a circular cross section shall have an outside diameter of 1 1/4 inches (32 mm) minimum and 2 inches (51 mm) maximum.

505.7 Cross Section. Handrail gripping surfaces shall have a cross section

505.7.2 Non-Circular Cross Sections. Handrail gripping surfaces with a non-circular cross section shall have a perimeter dimension of 4 inches (100 mm) minimum and 6 1/4 inches (160 mm) maximum, and a cross-section

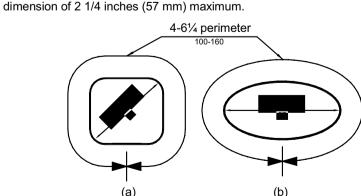


Figure 505.7.2 Handrail Non-Circular Cross Section

505.8 Surfaces. Handrail gripping surfaces and any surfaces adjacent to them shall be free of sharp or abrasive elements and shall have rounded edges. **505.9 Fittings.** Handrails shall not rotate within their fittings. 505.10 Handrail Extensions. Handrail gripping surfaces shall extend beyond and in the same direction of stair flights and ramp runs in accordance with

1. Extensions shall not be required for continuous handrails at the inside turn of switchback or dogleg stairs and ramps.

2. In assembly areas, extensions shall not be required for ramp handrails in aisles serving seating where the handrails are discontinuous to provide access to seating and to permit crossovers within aisles.

3. In alterations, full extensions of handrails shall not be required where such extensions would be hazardous due to plan configuration. **505.10.1 Top and Bottom Extension at Ramps.** Ramp handrails shall extend horizontally above thelanding for 12 inches (305 mm) minimum beyond the top and bottom of ramp runs. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent ramp run.




Figure 505.10.1 Top and Bottom Handrail Extension at Ramps

505.10.2 Top Extension at Stairs. At the top of a stair flight, handrails shall extend horizontally above the landing for 12 inches (305 mm) minimum beginning directly above the first riser nosing. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an




Figure 505.10.2 Top Handrail Extension at Stairs

505.10.3 Bottom Extension at Stairs. At the bottom of a stair flight, handrails shall extend at the slope of the stair flight for a horizontal distance at least equal to one tread depth beyond the last riser nosing. Extension shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adiacent stair flight.




Figure 505.10.3 Bottom Handrail Extension at Stairs

601.1 Scope. The provisions of Chapter 6 shall apply where required by Chapter 2 or where referenced by a requirement in this document.

602 Drinking Fountains 602.1 General. Drinking fountains shall comply with 307 and 602. **602.2 Clear Floor Space**. Units shall have a clear floor or ground space complying with 305 positioned for a forward approach and centered on the unit. Knee and toe clearance complying with 306 shall be provided. **EXCEPTION:** A parallel approach complying with 305 shall be permitted at units for children's use where the spout is 30 inches (760 mm) maximum above the finish floor or ground and is 3 1/2 inches (90 mm) maximum from the front edge

of the unit, including bumpers. **602.3 Operable Parts.** Operable parts shall comply with 309.

602.4 Spout Height. Spout outlets shall be 36 inches (915 mm) maximum above the finish floor or ground. **602.5 Spout Location.** The spout shall be located 15 inches (380 mm)

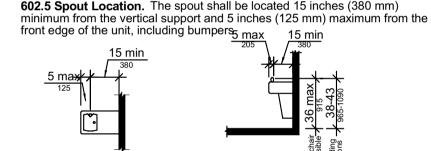


Figure 602.5 Drinking Fountain Spout Location

602.6 Water Flow. The spout shall provide a flow of water 4 inches (100 mm) high minimum and shall be located 5 inches (125 mm) maximum from the front of the unit. The angle of the water stream shall be measured horizontally relative to the front face of the unit. Where spouts are located less than 3 inches (75 mm) of the front of the unit, the angle of the water stream shall be 30 degrees maximum. Where spouts are located between 3 inches (75 mm) and 5 inches (125 mm) maximum from the front of the unit, the angle of the water stream shall

be 15 degrees maximum. 602.7 Drinking Fountains for Standing Persons. Spout outlets of drinking fountains for standing persons shall be 38 inches (965 mm) minimum and 43 inches (1090 mm) max. above the finish floor or ground.

603 Toilet and Bathing Rooms **603.1 General.** Toilet and bathing rooms shall comply with 603. **603.2 Clearances.** Clearances shall comply with 603.2.

603.2.1 Turning Space. Turning space complying with 304 shall be provided **603.2.2 Overlap.** Required clear floor spaces, clearance at fixtures, and turning space shall be permitted to overlap.

603.2.3 Door Swing. Doors shall not swing into the clear floor space or clearance required for any fixture. Doors shall be permitted to swing into the required turning space. **EXCEPTIONS**:

1. Doors to a toilet room or bathing room for a single occupant accessed only through a private office and not for common use or public use shall be permitted to swing into the clear floor space or clearance provided the swing of the door can be reversed to comply with 603.2.3. 2. Where the toilet room or bathing room is for individual use and a clear floor space complying with 305.3 is provided within the room beyond the arc of the door swing, doors shall be permitted to swing into the clear floor space or clearance required for any fixture.

603.3 Mirrors. Mirrors located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 40 inches (1015 mm) maximum above the finish floor or ground. Mirrors not located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 35 inches (890 mm) maximum above the finish floor or ground. 603.4 Coat Hooks and Shelves. Coat hooks shall be located within one of the reach ranges specified in 308. Shelves shall be located 40 inches (1015 mm)

603.5 Diaper Changing Tables. Diaper changing tables shall comply with Sections 309 and 902. **603.6 Operable Parts.** Operable parts on towel dispensers and hand dryers serving accessible lavatories shall comply with Table 603.6.

minimum and 48 inches (1220 mm) maximum above the finish floor.

Table 603.6 Maximum Reach Depth and Height 2 inches 5 inches 6 inches 9 inches 11 inches (51 mm) (125 mm) (150 mm) (230 mm) (280 mm)

 Maximum
 48 inches
 46 inches
 42 inches
 40 inches
 36 inches
 34 inches

 Reach Height(1220 mm)
 (1170 mm)
 (1065 mm)
 (1015 mm)
 (915 mm)
 (865 mm)

604 Water Closets and Toilet Compartments **604.1 General.** Water closets and toilet compartments shall comply with 604.2 **EXCEPTION:** Water closets and toilet compartments for children's use shall be permitted to comply with 604.9.

604.2 Location. The water closet shall be positioned with a wall or partition to the rear and to one side. The centerline of the water closet shall be 16 inches (405 mm) minimum to 18 inches (455 mm) maximum from the side wall or partition, except that the water closet shall be 17 inches (430 mm) minimum and 19 inches (485 mm) maximum from the side wall or partition in the ambulatory accessible toilet compartment specified in 604.8.2. Water closets shall be arranged for a left-hand or right-hand




Figure 604.2 Water Closet Location

604.3 Clearance. Clearances around water closets and in toilet compartments

shall comply with 604.3 **604.3.1 Clearance width.** Clearance around a water closet shall be 60 inches (1525 mm) minimum measured perpendicular from the side wall **604.3.2 Clearance Depth. Cl** earance around the water closet shall be 56 inches (1420 mm) minimum measured perpendicular from the rear wall.





Figure 604.3.1 Size of Clearance for Water Closets

604.3.3 Clearance Overlap. The required clearance around the water closet shall be permitted to overlap the water closet, associated grab bars, dispensers, sanitary napkin disposal units, coat hooks, shelves, accessible routes, clear floor space and clearances required at other fixtures, and the turning space. No other fixtures or obstructions shall be located within the required water closet

604.4 Height. The height of a water closet seat shall be 17 inches (430 mm) minimum and 19 inches (485 mm) maximum above the floor, measured to the top of the seat. Seats shall not be sprung to return to a lifted position. **EXCEPTIONS:** A water closet in a toilet room for a single occupant accessed only through a private office and not for common use or public use shall not be required to comply with 604.4.



Note: For children's dimensions see Fig. 604.11.4 Figure 604.4 Water Closet Seat Height

604.5 Grab Bars. Grab bars for water closets shall comply with 609 and shall be provided in accordance with Sections 604.5.1 and 604.5.2. Grab bars shall provided on the rear wall and on the side wall closest to the water closet...

1. Grab bars shall not be required to be installed in a toilet room for a single occupant accessed only through a private office and not for common use or public use provided that reinforcement has been installed in walls and located so as to permit the installation of grab bars complying with 604.5. 2. In detention or correction facilities, grab bars shall not be required to be installed in housing or holding cells that are specially designed without protrusions for purposes of suicide prevention

604.5.1 Fixed Side Wall Grab Bars. Fixed side-wall grab bars shall be 42 from the rear wall and extending 54 inches (1370 mm) minimum from the rear wall. In addition, a vertical grab bar 18 inches (455 mm) minimum in length shall be mounted with the bottom of the bar located 39 inches (990mm) minimum and 41 inches (1040 mm) maximum above the floor, and with the center line of the bar located 39 inches (990mm) minimum and 41 inches (1040 mm) maximum from the rear wall

EXCEPTION: The vertical grab bar at water closets primarily for children's use




Figure 604.5.1 Side Wall Grab Bar for Water Closets

604.5.2 Rear Wall. The rear wall grab bar shall be 36 inches (915 mm) long minimum and extend from the centerline of the water closet 12 inches (305 mm) minimum on one side and 24 inches (610mm) minimum on the other side.

EXCEPTIONS: 1. The rear grab bar shall be permitted to be 24 inches (610 mm) long minimum, centered on the water closet, where wall space does not permit a length of 36 inches (915 mm) minimum due to the location of a recessed fixture adjacent to the water closet. 2. Where an administrative authority requires flush controls for flush valves to be located in a position that conflicts with the location of the rear grab bar, then the

rear grab bar shall be permitted to be split or shifted to the open side of the toilet




Figure 604.5.2 Rear Wall Grab Bar at Water Closets

604.6 Flush Controls. Flush controls shall be hand operated or automatic. Hand operated flush controls shall comply with Section 309. Flush controls shall be located on the open side of the water closet. **EXCEPTION:** In ambulatory accessible compartments complying with Section 604.10, flush controls shall be permitted to be located on either side of the water

604.7 Dispensers. Toilet paper dispensers shall comply with 309.4 and shall be 7 inches (180 mm) minimum and 9 inches (230 mm) maximum in front of the water closet measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches (380 mm) minimum and 48 inches (1220 mm) maximum above the finish floor and shall not be located behind grab bars. Dispensers shall not be of a type that controls delivery or that does not allow continuous paper flow.




Figure 604.7 Dispenser Outlet Location

604.8 Coat Hooks and Shelves. Coat hooks provided within toilet compartments shall be 48 inches (1220 mm) maximum above the floor. shelves shall be 40 inches (1015 mm) minimum and 48 inches (1220 mm) maximum above the floor. 604.9 Wheelchair Accessible Compartments. Wheelchair accessible

compartments shall comply with 604.9. **604.9.2 Size.** Toilet compartments shall comply with Section 604.9.2.1 or 604.9.2.2 as applicable.

604.9.2.1 Minimum area. The minimum area of a wheelchair accessible

compartments shall be 60 inches (1525 mm) wide minimum measured perpendicular to the side wall, and 56 inches (1420 mm) deep minimum for wall nung water closets and 59 inches (1500 mm) deep minimum for floor mounted water closets measured perpendicular to the rear wall. 604.9.2.2 Compartment for children's use. The minimum area of a wheelchair accessible compartment primarily for children's use shall be 60 inches (1525) mm) minimum in width measured perpendicular to the side wall, and 59 inches


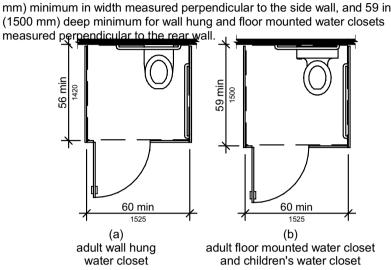


Figure 604.9.2 Wheelchair Accessible Toilet Compartment

604.9.3 Doors. Toilet compartment doors, including door hardware, shall comply with Section 404 except that if the approach is to the latch side of the compartment door, clearance between the door side of the compartment and any obstruction shall be 42 inches (1065 mm) minimum. The door shall be self-closing. A door pull complying with 404.2.6 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the minimum required compartment.

604.9.3.1 Door Opening Location. The farthest edge of toilet compartment door opening shall be located in the front wall or partition or in the side wall or partition as required by Table 604.9.3.1. Table 604.9.3.1 - Door Opening location

Door Opening Location	Measured From	Dimension
Front Wall or Partition	From the side wall or partition closest to the water closet	56 inches (1420 mm) minimum
	or	
	From the side wall or partition farthest from the water closet	4 inches (100 mm) maximum
Side Wall or Partition Wall-Hung Water Closet	From the rear wall	52 inches (1320 mm) minimum
	or	
	From the front wall or partition	4 inches (100 mm) maximum
Side Wall or Partition Floor-mounted Water Closet	From the rear wall	55 inches (1395 mm) minimum
	or	•
	From the front wall or partition	4 inches (100 mm) maximum

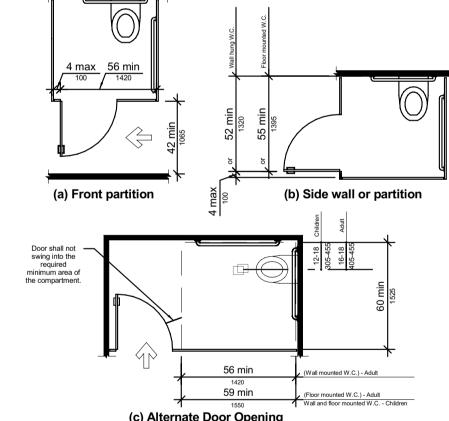

(c) Alternate Door Opening Figure 604.9.3.1 Wheelchair Accessible Toilet Compartment Door Openings

604.9.4 Approach. Wheelchair accessible compartments shall be arranged for left-hand or right-hand approach to the water closet. **604.9.5 Toe Clearance.** Toe clearance for compartments primarily for children's use shall comply with Section 604.9.5.2. Toe clearance for other wheel chair accessible compartments shall comply with Section 604.9.5.1. **604.9.5.1. Toe Clearance at Compartments.** The front partition and at least one side partition shall provide a toe clearance of 9 inches (230 mm) min. above the floor and extending 6 inches (150 mm) beyond the compartment side face of the partition, exclusive of partition support members.

EXCEPTIONS: 1. Toe clearance at the front partition is not required in a compartment greater than 62 inches (1575 mm) in depth with a wall-hung water closet, or greater than 65 inches (1650 mm) in depth with a floor-mounted water closet. Toe clearance at the side partition is not required in a compartment greater than 66 inches (1675 mm) wide. 2. Toe clearance at the side partition is not required in a compartment greater

than 66 inches (1675 mm) in width.

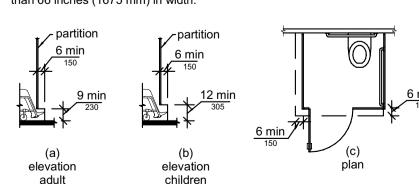


Figure 604.9.5 Wheelchair Accessible Toilet Compartment Toe Clearance

604.9.5.2 Toe Clearance at Compartments for Children's Use. The front partition and at least one side partition of compartments primarily for children's use shall provide a toe clearance of 12 inches (305 mm) minimum above the floor and extending 6 inches (150 mm) beyond compartment side face of the partition, exclusive of partition support members.

1. Toe clearance at the front partition is not required in a compartment greater than 65 inches (1650 mm) in depth 2. Toe clearance at the side partition is not required in a compartment greater than 66 inches (1675 mm) in width.

604.9.6 Grab Bars. Grab bars shall comply with Section 609. Side-wall grab bars complying with 604.5.1 located on the wall closest to the water closet, and a rear wall grab bar complying with 604.5.2 shall be provided. 604.10 Ambulatory Accessible Compartments.




Figure 604.8.2 Ambulatory Accessible Compartment

604.10.1 General. Ambulatory accessible compartments shall comply with Section 604.10.


604.10.2 Size. The minimum area of an ambulatory accessible compartments shall have a depth of 60 inches (1525 mm) minimum and 36 inches (915 mm) in

604.10.3 Doors. Toilet compartment doors, including door hardware, shall comply with Section 404, except that if the approach is to the latch side of the compartment door, the clearance between the door side of the compartment and any obstruction shall be 42 inches (1065 mm) minimum. The door shall be self-closing. A door pull complying with 404.2.6 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the minimum required compartment area.

604.10.4. Grab Bars. Grab bars shall comply with 609. A side-wall grab bar complying with 604.5.1 shall be provided on both sides of the compartment.

605.1 General. Urinals shall comply with 605 605.2 Height and Depth. Urinals shall be the stall-type or the wall-hung type

with the rim 17 inches (430 mm) maximum above the finish floor or ground. Urinals shall be 13 1/2 inches (345 mm) deep minimum measured from the outer face of the urinal rim to the well min



605.3 Clear Floor Space. A clear floor or ground space complying with 305 positioned for forwardapproach shall be provided. **605.4 Flush Controls.** Flush controls shall be hand operated or automatic. Hand operated flush controls shall comply with 309.

606 Lavatories and Sinks

606.1 General. Lavatories and sinks shall comply with 606. **606.2 Clear Floor Space.** A clear floor space complying with 305.3, positioned for a forward approach, and knee and toe clearance complying with 306 shall be provided. The dip of the overflow shall no be considered in determining knee and

1. A parallel approach complying with 305 shall be permitted to a kitchen sink in a space where a cook top or conventional range is not provided and to wet bars. 2. A lavatory in a toilet room or bathing facility for a single occupant accessed only through a private office and not for common use or public use shall not be required to provide knee and toe clearance. **3.** A knee clearance of 24 inches (610 mm) minimum above the finish floor shall be permitted at lavatories and sinks used primarily by children 6 through 12

vears where the rim or counter surface is 31 inches (785 mm) maximum above **4.** A parallel approach complying with 305 and centered on the sink, shall be permitted at lavatories and sinks used primarily by children 5 years and younger. **5.** The requirement for knee and toe clearance shall not apply to more than one bowl of a multi-bowl sink.

6. A parallel approach complying with Section 305 and centered on the sink, shall be permitted at wet bars. **606.3 Height.** The front of lavatories and sinks shall be 34 inches (865 mm)

maximum above the finish floor, measured to the higher of the rim or counter **EXCEPTIONS:** A lavatory in a toilet or bathing facility for a single occupant accessed only through a private office and not for common use or public use shall not be required to comply with 606.3.

606.4 Faucets. Controls for faucets shall comply with 309. Hand-operated metering faucets shall remain open for 10 seconds minimum. **606.5 Lavatories with Enhanced Reach Range.** Where enhanced reach range is required at lavatories, faucets and soap dispenser controls shall have a reach depth of 11 inches (280 mm) maximum or, if automatic shall be activated within a reach depth of 11 inches (280 mm) maximum. Water and soap flow shall be provided with a reach depth of 11 inches (280 mm) maximum. **606.5 Exposed Pipes and Surfaces.** Water supply and drain pipes under lavatories and sinks shall be insulated or otherwise configured to protect against contact. There shall be no sharp or abrasive surfaces under lavatories and sinks **609.1 General.** Grab bars in toilet facilities and bathing facilities shall comply

609.2 Cross Section. Grab bars shall have a cross section complying with **609.2.1 Circular Cross Section.** Grab bars with circular cross sections shall

have an outside diameter of 1 1/4 inches (32 mm) minimum and 2 inches (51 **609.2.2 Non-Circular Cross Section**. Grab bars with non-circular cross sections shall have a cross section dimension of 2 inches (51 mm) max. and a

perimeter dimension of 4 inches (100 mm) minimum and 4.8 inches (120 mm) 4-4.8 perimeter

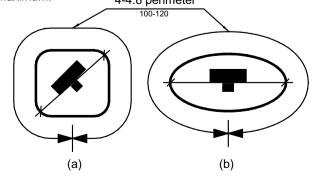


Figure 609.2.2 Grab Bar Non-Circular Cross Section

609.3 Spacing. The space between the wall and the grab bar shall be 1 1/2 inches (38 mm). The space between the grab bar and projecting objects below and at the ends shall be 1 1/2 inches (38 mm) minimum. The space between the grab bar and projecting objects above shall be 12 inches (305 mm) minimum. **EXCEPTION:** The space between the grab bars and shower controls, shower fittings, and other grab bars above shall be permitted to be 1 1/2 inches (38 mm)




Figure 609.3 Spacing of Grab Bars

609.4 Position of Grab Bars. Grab bars shall be installed in a horizontal position, 33 inches (840 mm) minimum and 36 inches (915 mm) maximum above the finish floor measured to the top of the gripping surface, except that at water closets for children's use complying with 604.9, grab bars shall be installed in a horizontal position 18 inches (455 mm) minimum and 27 inches (685 mm) maximum above the finish floor measured to the top of the gripping surface. The height of the lower grab bar on the back wall of a bathtub shall comply with 607.4.1.1 or 607.4.2.1.

609.5 Surface Hazards. Grab bars and any wall or other surfaces adjacent to grab bars shall be free of sharp or abrasive elements and shall have rounded

609.6 Fittings. Grab bars shall not rotate within their fittings. **609.7 Installation.** Grab bars shall be installed in any manner that provides a gripping surface at the specified locations and that does not obstruct the

required clear floor space. **609.8 Structural Strength.** Allowable stresses shall not be exceeded for materials used when a vertical or horizontal force of 250 pounds (1112 N) is applied at any point on the grab bar, fastener, mounting device, or supporting



8225 Kingston Pike

Knoxville, TN 37919

Owner:

CEC ENTERTAINMENT, INC. 1707 Market Place Blvd. Suite 200 Irving, TX 77063 Ph: 972-258-5521 Contact: Walter Boyd


Architect:

Parkway C&A, LP 1000 Civic Circle Lewisville, TX 75287 Ph: 972-221-1979 Contact: Michael Orr

MEP Engineer:

Dialectic Engineering 310 W 20th Street 200 Kansas City, MO 64108 Ph: (816)997.9627 Contact: Joe Hillebrenner, P.E.

Design Directive: 43



Permit Set No. Description

William D. Pounds.

DRAWN BY: CH CHECKED BY: VG PROJ. NO: 04-21829

Parkway C&A, LP © 2021

Accessibility Standard